

Talco Fire Systems

Residential & Commercial Packaged Fire Pump Specialists

Portland, Oregon

ULR-100

w/Test Port, Flow Meter, City By-Pass, Jockey Pump
Listed Fire Pump & Controller
NFPA-20 Compliant Packaged System

Controller: _____

Jockey Pump: _____


Jockey Controller: _____

Suction x Discharge: 3" Grooved x 2 1/2" Grooved


100GPM

2 x 2 - 9C

| PSI (range) | Motor HP |
|-------------|----------|
| 66-90 | 10 |
| 91-115 | 15 |
| 116-130 | 20 |
| 131-150 | 25 |

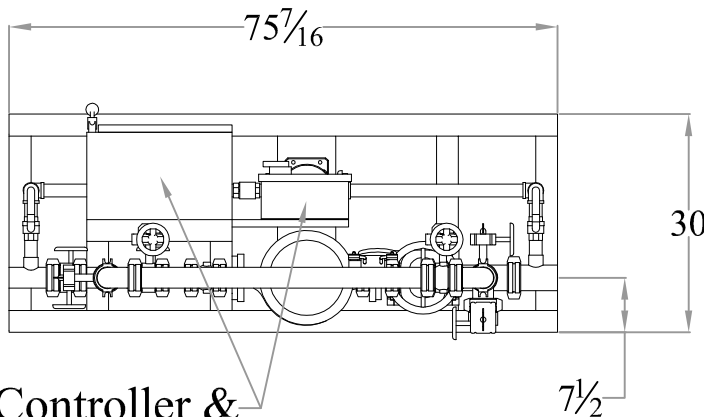

Main Controller &
Jockey Controller

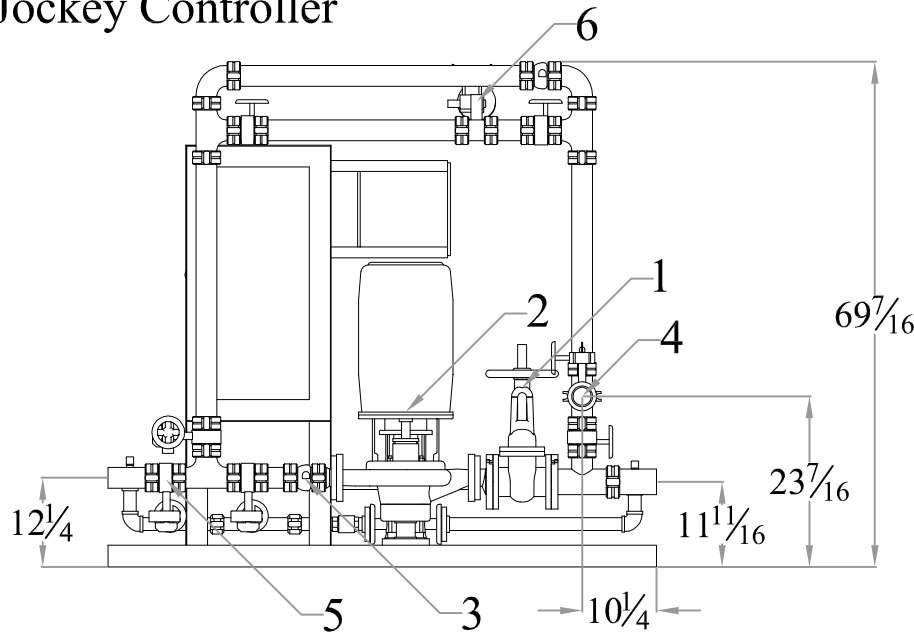

DESIGN CONDITIONS

_____ GPM @ _____ PSI
_____ HP _____ V _____ Phase

Project: _____

Contractor: _____

Date: _____

P.O.: _____

System Components

| | |
|---|----------------------|
| 1 | OS&Y Gate Valve |
| 2 | Inline Pump & Motor |
| 3 | Check Valve |
| 4 | Test Port Connection |
| 5 | Monitored Butterfly |
| 6 | Flow Meter |

Approximate ship weight: < 900#

Phone: (800) 878-8055

www.talcofire.com

Fax: (503) 688-1234