

# Talco Fire Systems

Residential & Commercial Packaged Fire Pump Specialists

Portland, Oregon

## ULR-300

w/Test Port, City By-Pass, Jockey Pump  
Listed Fire Pump & Controller  
NFPA-20 Compliant Packaged System

Controller: \_\_\_\_\_

Jockey Pump: \_\_\_\_\_


Jockey Controller: \_\_\_\_\_

Suction x Discharge: 4" x 4" Grooved Fittings

## 300GPM

4 x 5 - 9 & 4 x 5 - 9B

PSI (range)	Motor HP
74-85	25
86-95	30
96-115	40
116-125	50
126-139	60

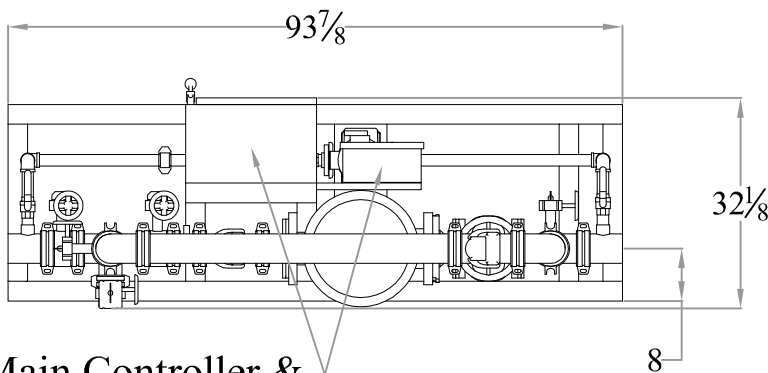


Main Controller &  
Jockey Controller

DESIGN CONDITIONS	
_____ GPM @ _____ PSI	
_____ HP _____ V _____ Phase	

Project: _____	
Contractor: _____	
Date: _____	P.O.: _____

System Components	
1	OS&Y Gate Valve
2	Inline Pump & Motor
3	Check Valve
4	Test Port Connection
5	Monitored Butterfly

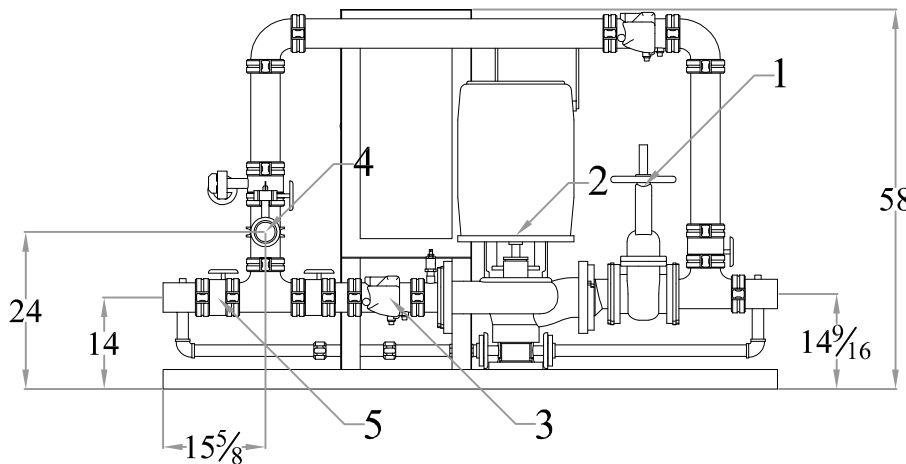

Approximate ship weight: < 1500#